

5876/15

5869/8

5869/13
5869/14

SD 400.KJ Velejny vodovod DN 200
SD 82.32 Kanaizacni pripojka B2
SD 520.KJ Velejny kanaizacni DN 300
SD A2.63 Plynov pripojka pre A2
SD B1.52 Kanaizacni pripojka B1
SD B1.40 Vodovodni pripojka B1
SD 830.2K Rozvody 0.4 KV


0.18-11.88-
6.54-
4.96-
4.28-
-38.29-
-16.14-
-11.15-
-125.49-
-9.06-
-5.18-
-6.56-
-8.72-
-3.78-
-11.33-
-27.25-
-126.89-
-40.72-
-90.40-
-99.56-

3071

* * * * *

3063/50

3063/51

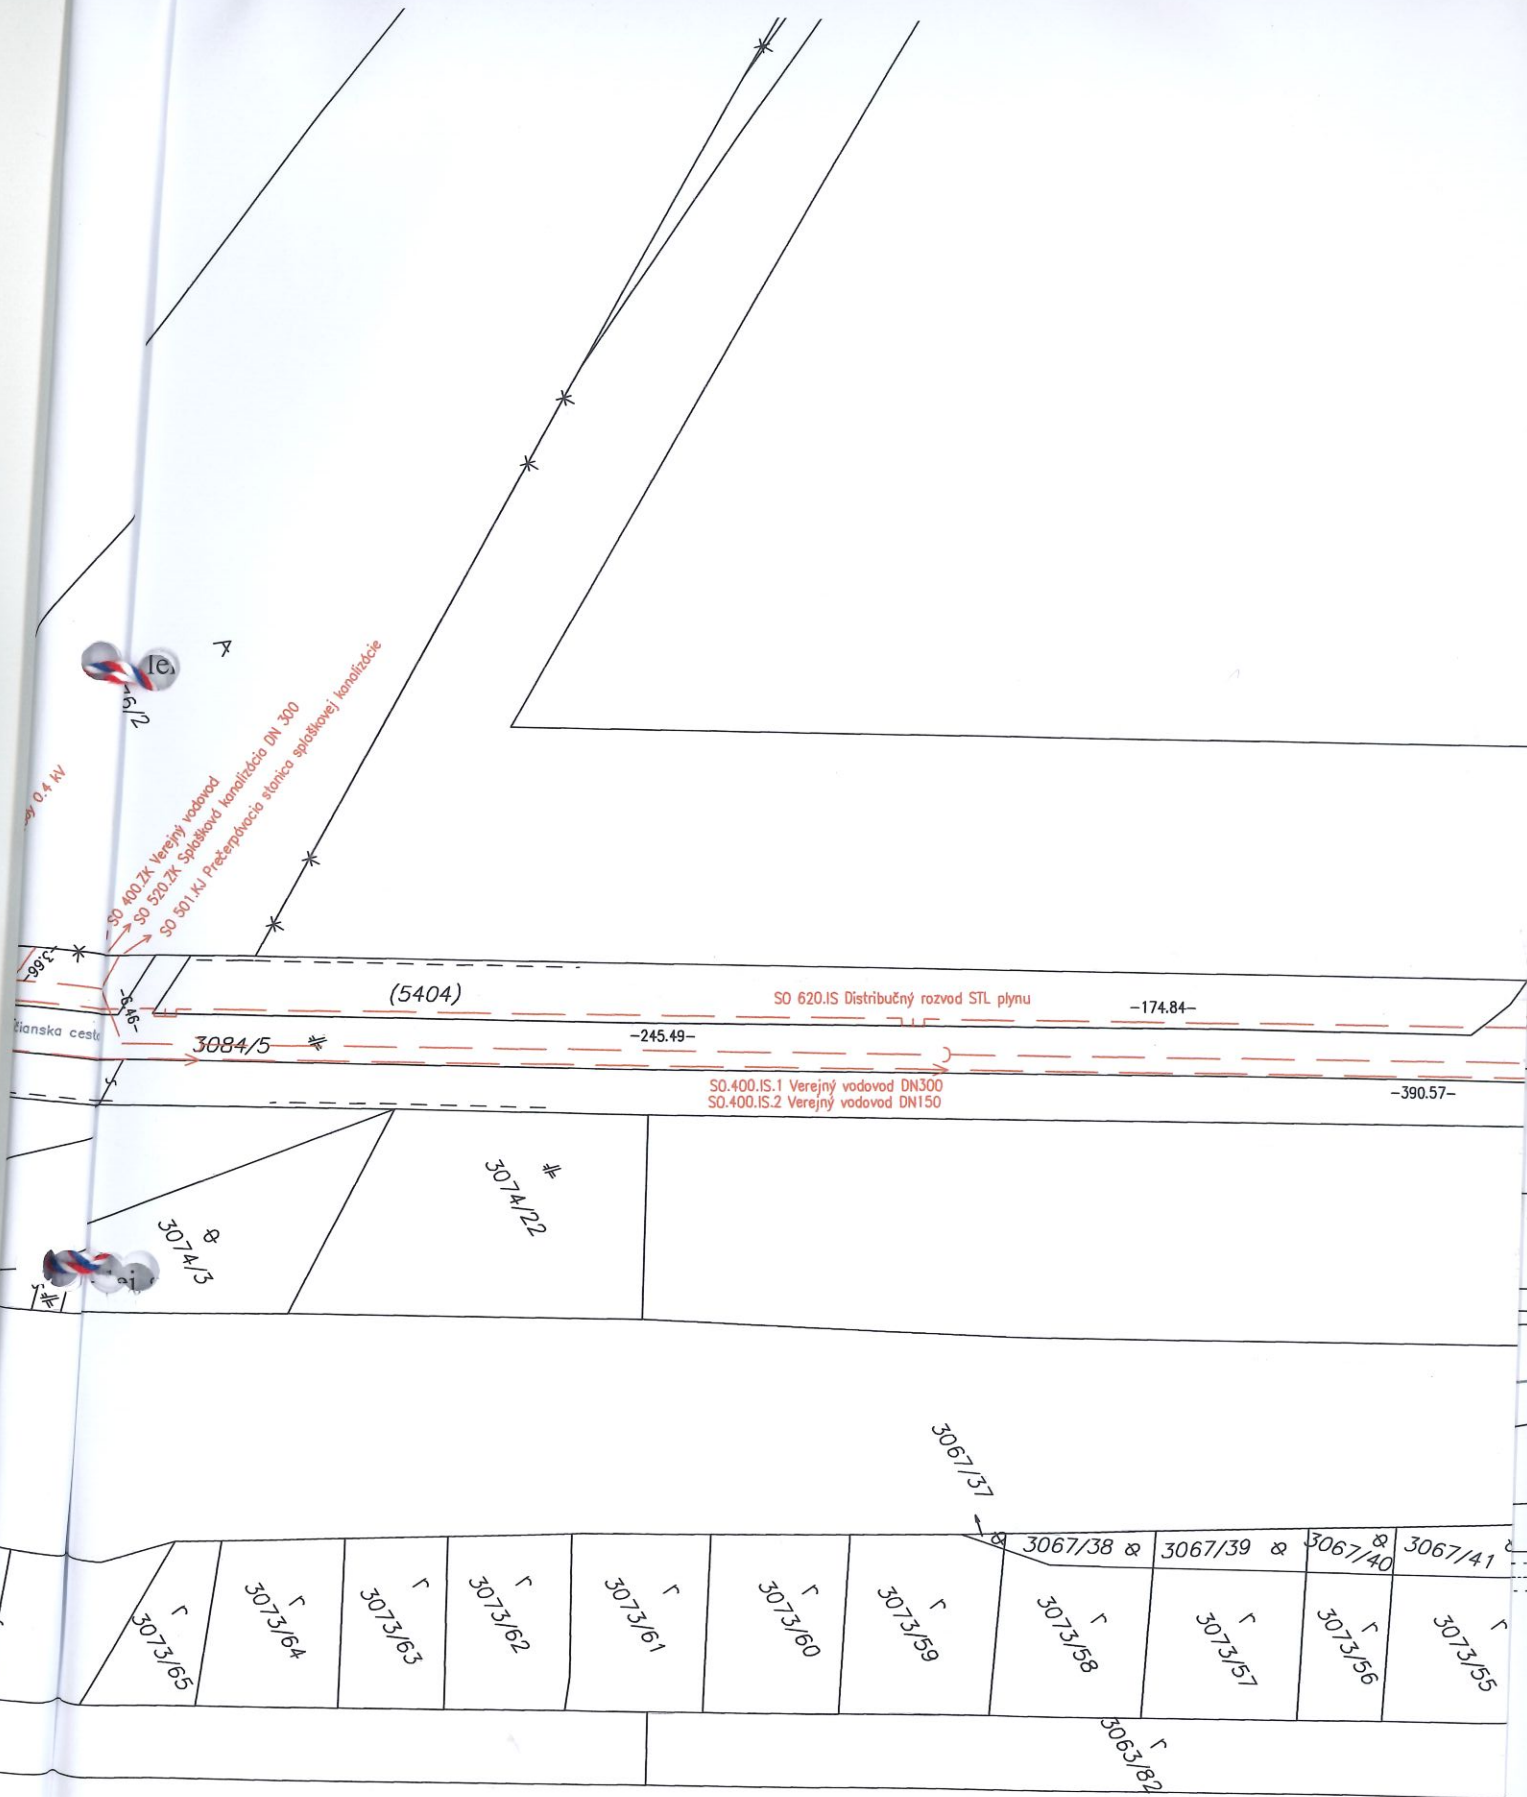

1c
0,4 kV
SO 400.7K Verejný vodovod
SO 520.2K Spôsobnosť kanalizácia DN 300
SO 501.KJ Prečerpávacia stanica spoločkovej kanalizácie

(5404)
SO 620.IS Distribučný rozvod STL plynu
-174.84-
-245.49-
3084/5
SO 400.IS.1 Verejný vodovod DN300
SO 400.IS.2 Verejný vodovod DN150
-390.57-
Križanska cesta

3074/12

3074/13

3067/37

3067/38 & 3067/39 & 3067/40 & 3067/41

3073/65 3073/64 3073/63 3073/62 3073/61 3073/60 3073/59 3073/58 3073/57 3073/56 3073/55

3063/82

p

366

5865

5864/11

-49.98-

SO 520JS Verejnd kanalizácia DN500

3074/2

3074/25

3074/26
3074/32
3074/33
3074/34
3074/35

3067/33
3067/34
3067/35
3067/36

3067/45

3067/32

3067/42
3067/43
3067/44
3073/54
3073/53
3073/52

3073/51

3073/50

3073/49

3073/48

3073/80

3073/81

3073/82

3073/83

3073/2

3073/75

3073/74

3073/79
3073/78
3073/77
3073/76

3073/70



5837/145

5837/151

5837/150

5837/114

5837/120

5837/2

5837/103

5837/147

5837/83

3083/56

3083/17

3/27

3074/21

3073/69


3074/29


3074/29

-50.12-

-45.34-

kanalizacja DN500

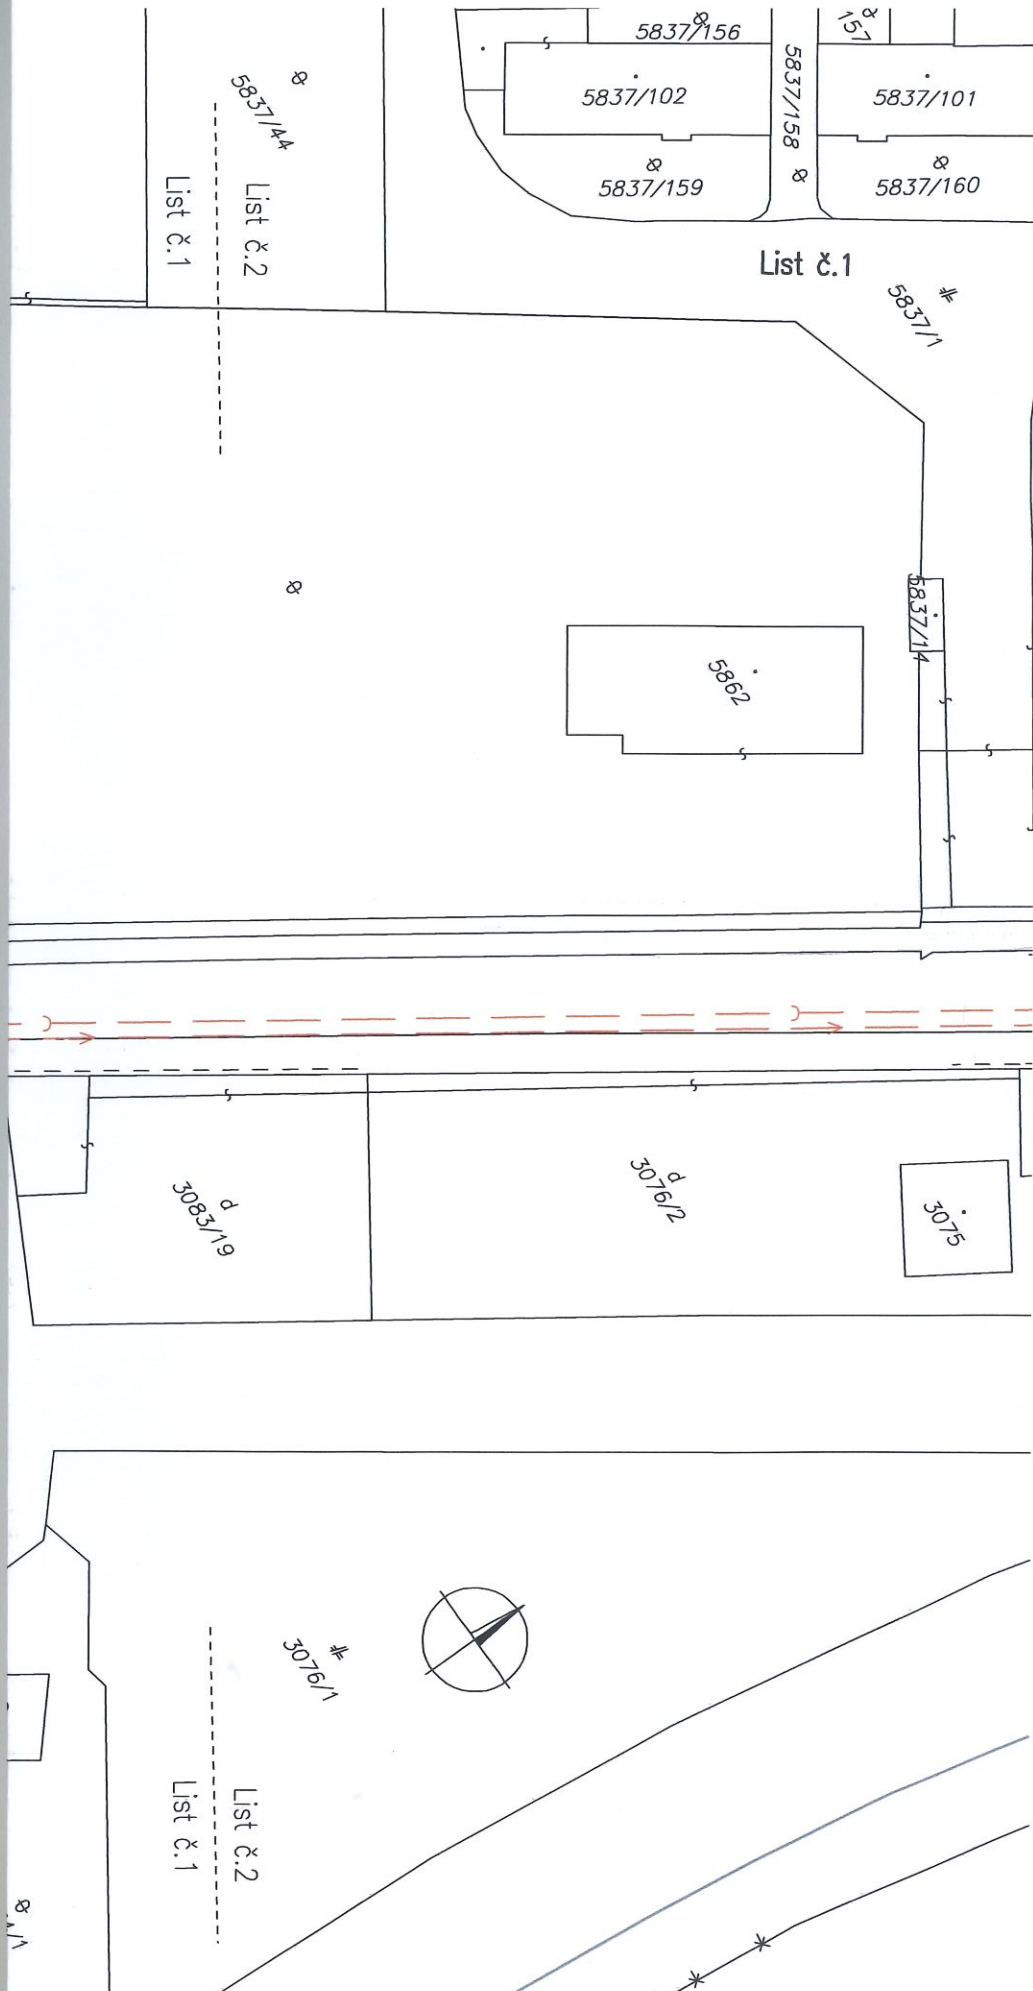

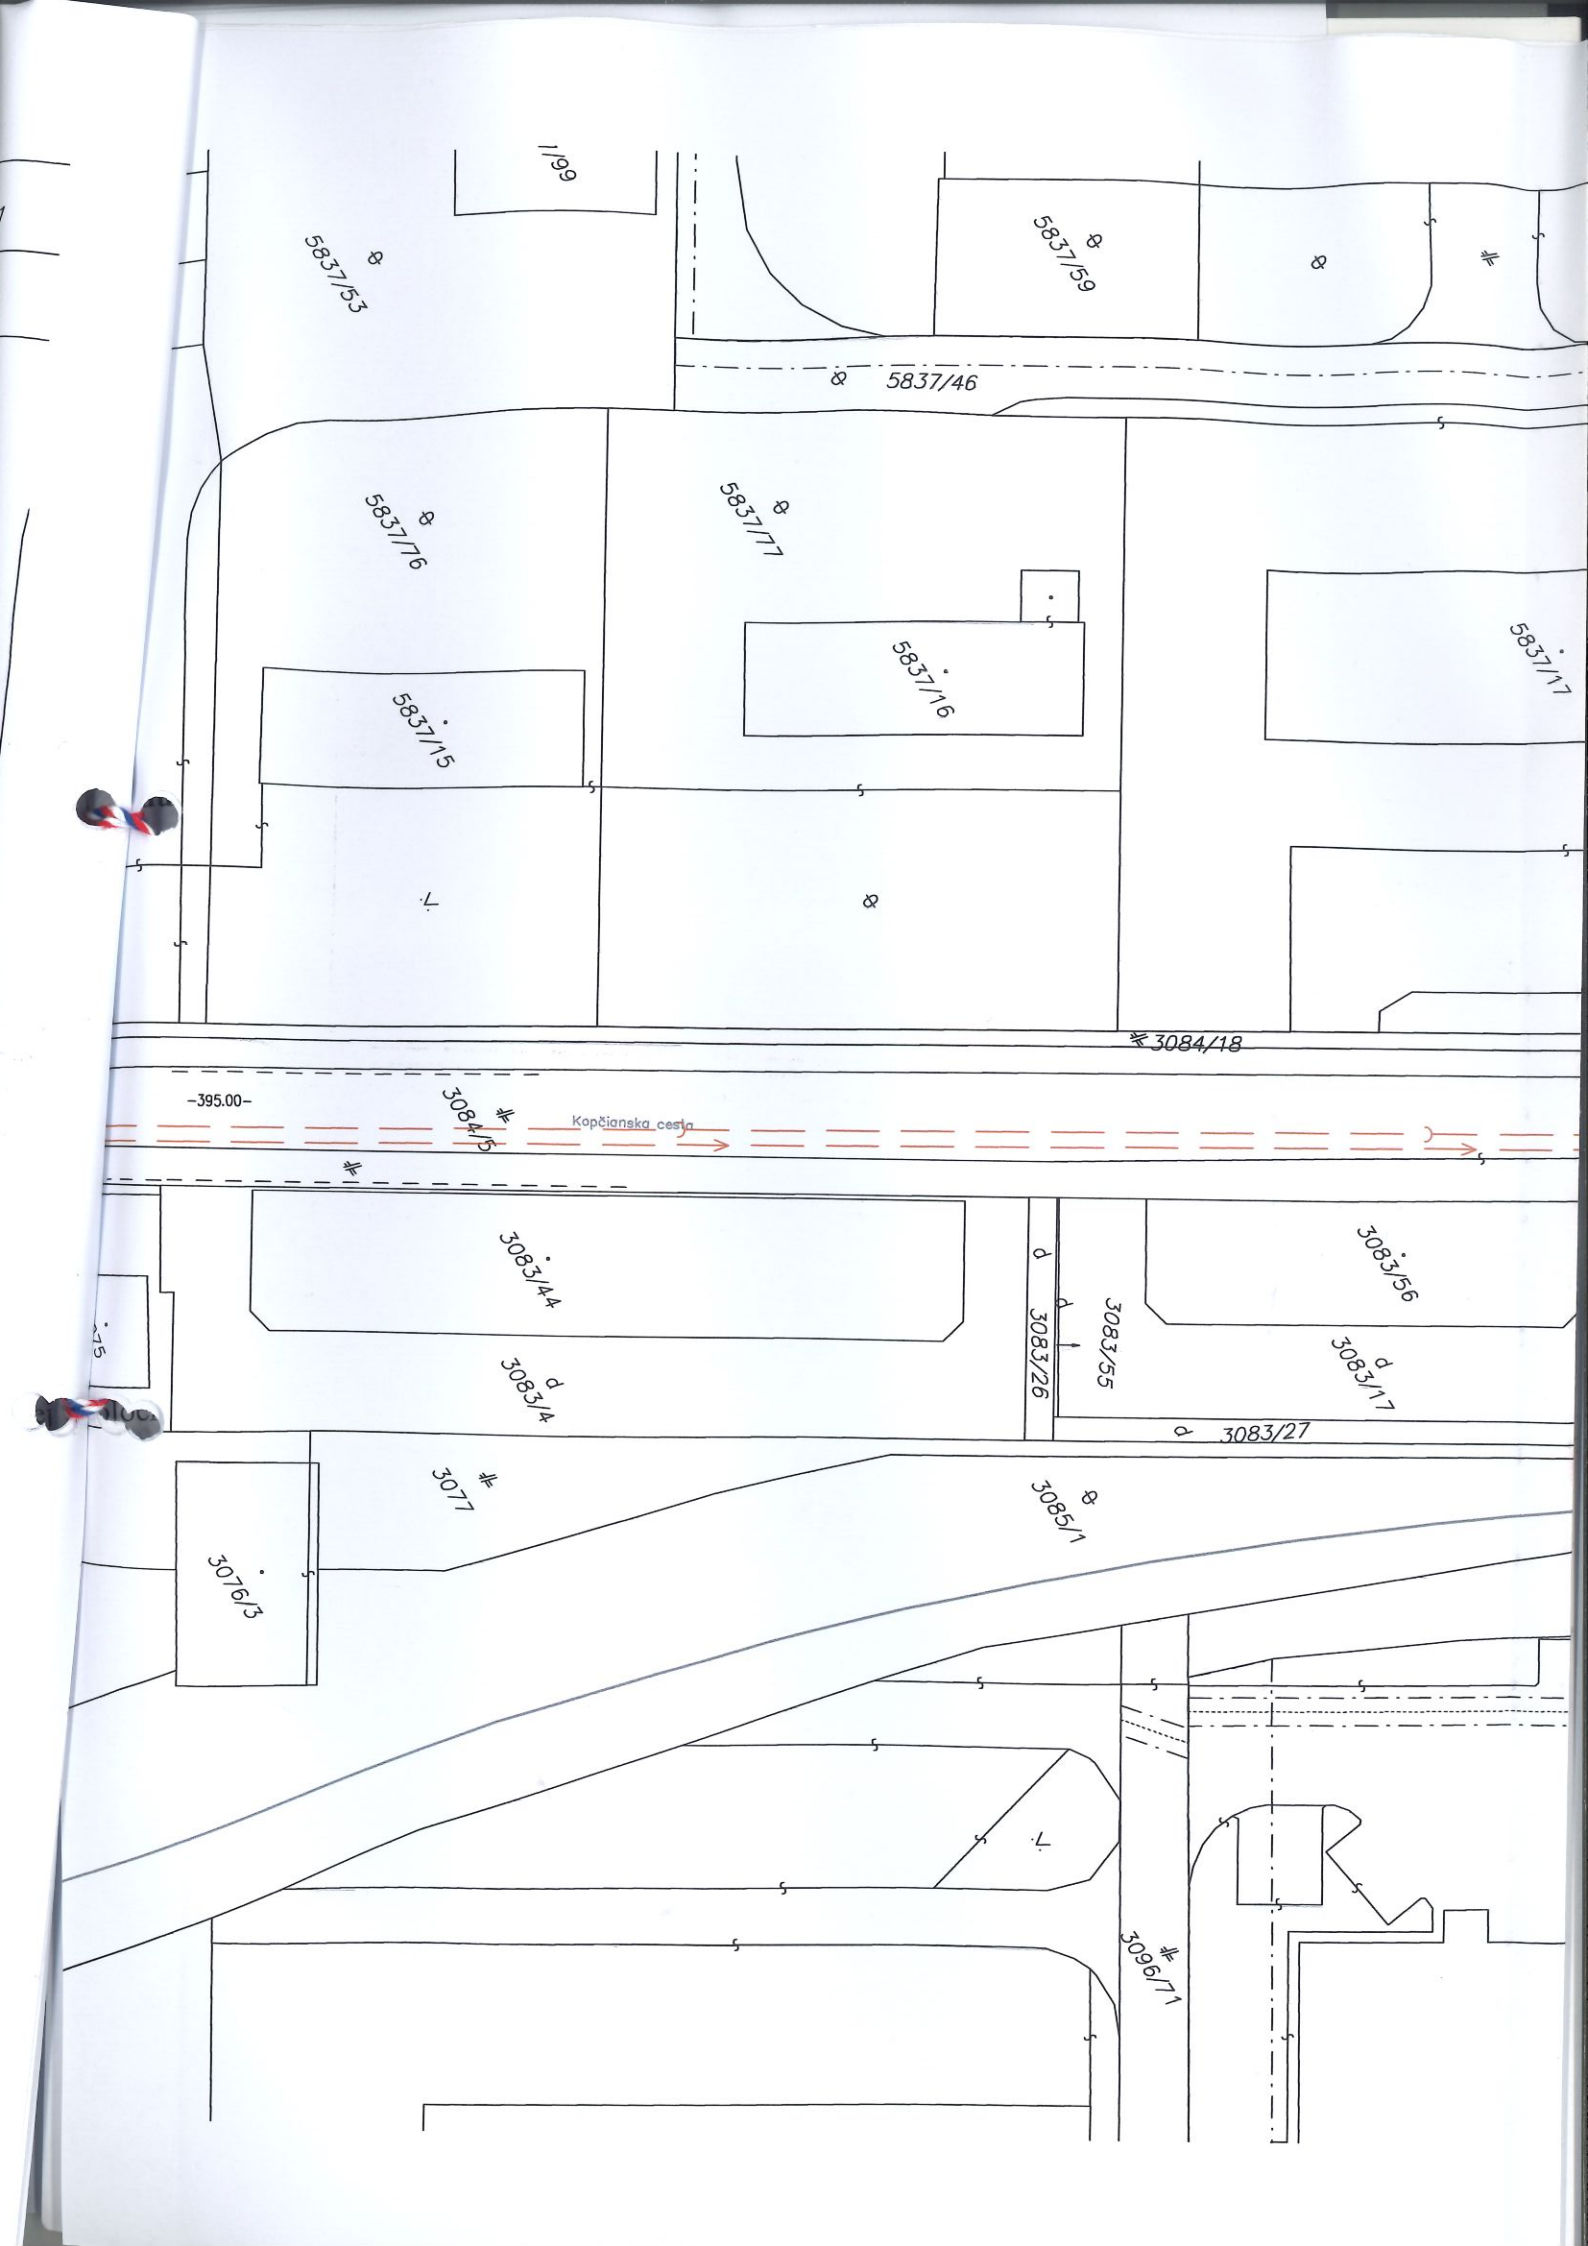

List č.2

